


ENGINEERING DIVISION

DEPARTMENT OF WATER, COUNTY OF KAUA'I
JASON F. KAGIMOTO, P.E.



JOSEPH E. TAIT
MANAGER AND CHIEF ENGINEER

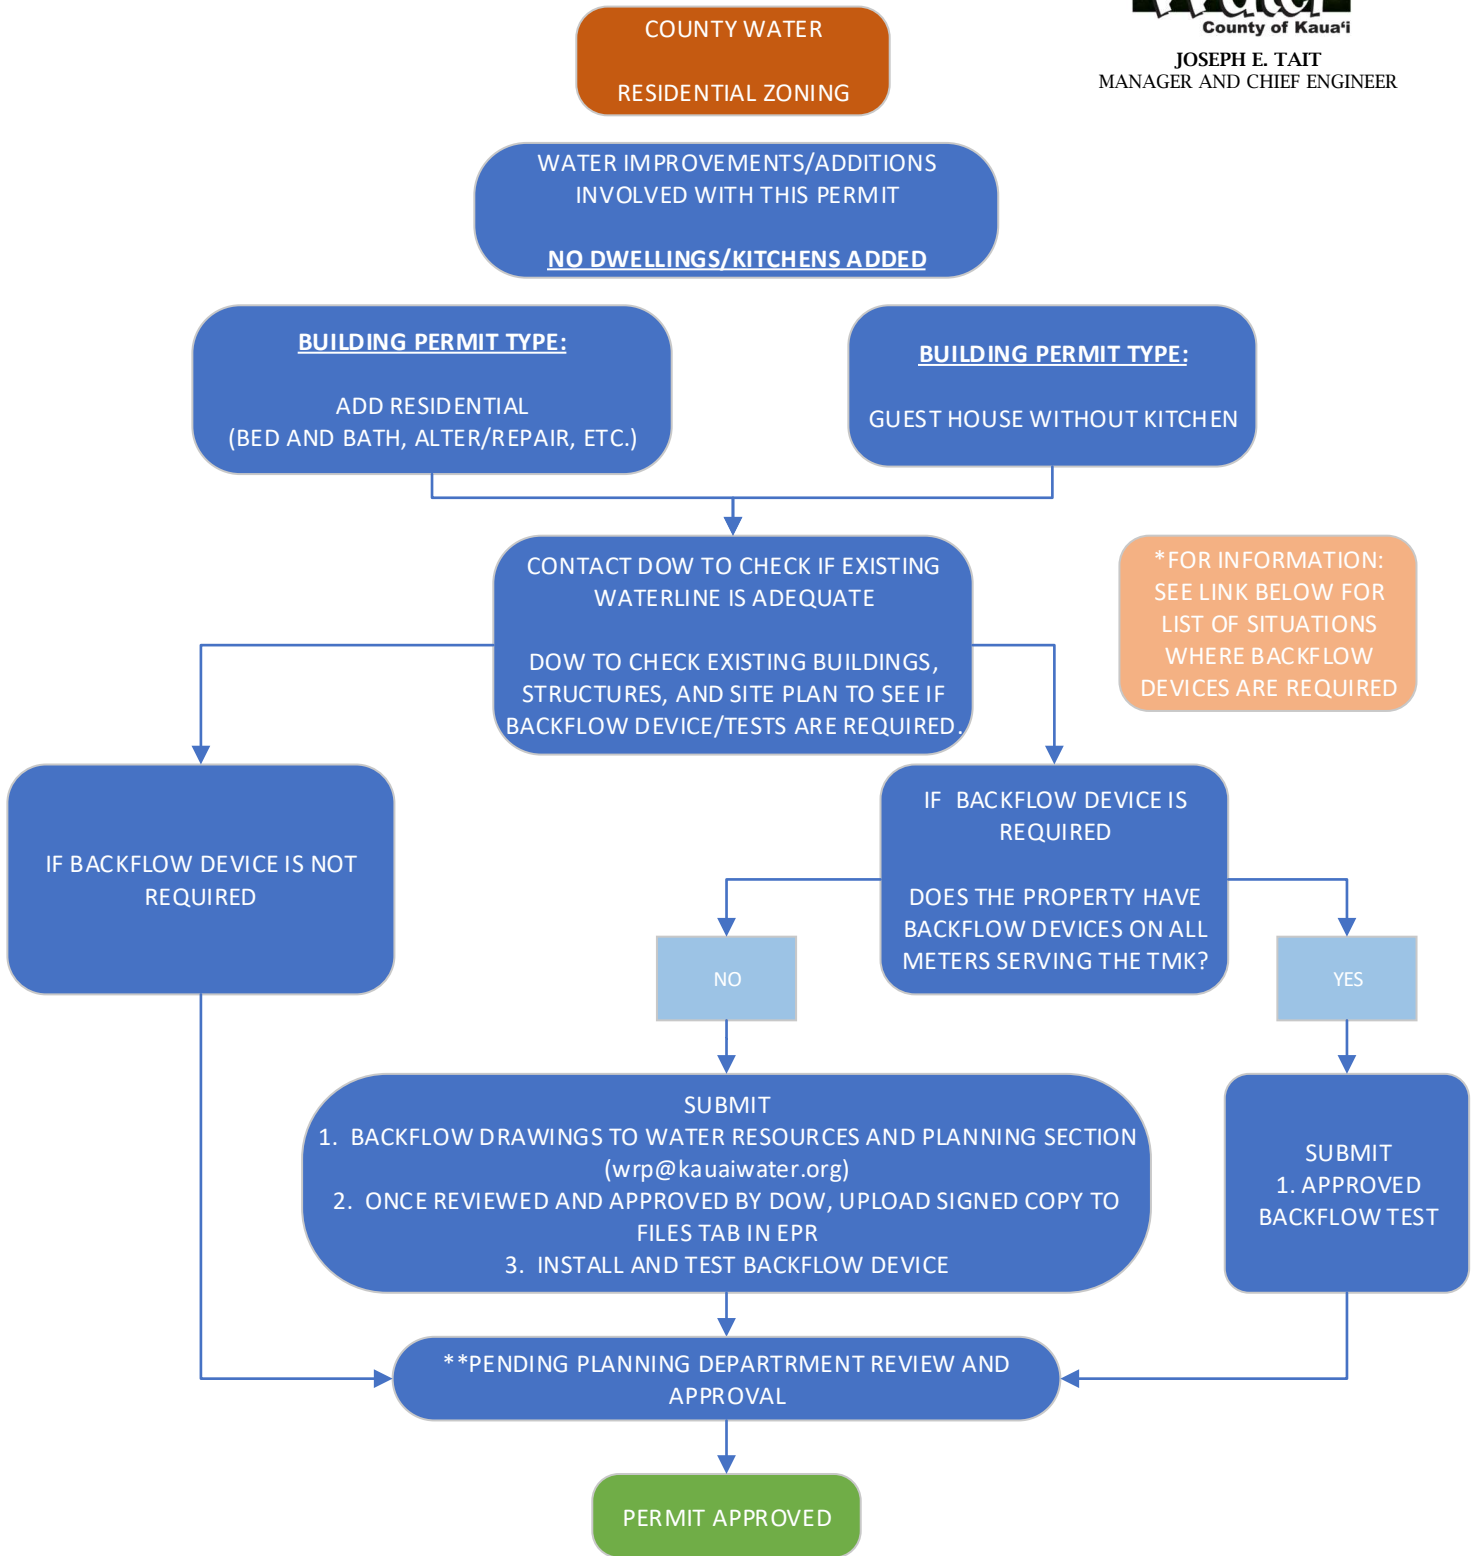

*BACKFLOW DEVICE REQUIREMENTS LINK: kauaiwater.org/WSS100.pdf (PAGES 107-1 THROUGH 107-5)
**PLANNING DEPARTMENT APPROVAL NEEDED FOR PROPOSED STRUCTURE TO CONFIRM THAT NO DWELLINGS/KITCHENS ARE BEING ADDED

FOR QUESTIONS: EMAIL - wrp@kauaiwater.org OR CALL - 808-245-5454